

Suitability of cationic flocculants for RO membranes performance improvement

N. Peña, F. del Vigo, O. Salmerón, J. Rodríguez, A. Borrell. Genesys Membrane Products, Spain.

S.P.Chesters. Genesys International Ltd, UK.

Main Contact: PhD. Nuria Peña, Genesys Membrane Products SL, C/ Londres 38, 28232, Madrid, Spain.

E-mail: npena@genesysro.es

ABSTRACT

As it has already been published and demonstrated, one of the main causes of membranes failures is related to a poor plant pre-treatment. Data from more than 600 autopsies demonstrated that both biofilm and colloidal matter are the most common components on RO (reverse osmosis) membranes fouling, therefore, main lack on membranes pre-treatment is related to disinfection and small size of the particles. In many cases, the dosing of chemicals such as biocides and flocculants is the only tool for membranes pre-treatment improvement.

Although on previous papers, cationic flocculants effectiveness was already proved, there is still a belief of risk in the use of this kind of products on RO pre-treatments.

Genesys Membrane Products laboratories has broad experience on the optimization of cationic flocculants use which proves the effectiveness of these products for RO pre-treatment with no risk for the membranes. This paper will demonstrate the compatibility of some cationic flocculant with membranes, as well as the compatibility of novel formulations including biocides in the flocculant formulation.

On this paper, the authors will review data from laboratory tests, case studies and compatibility tests carried out through different analytical techniques (SEM-EDX, ATR/FTIR, etc.) for the different flocculants developed by Genesys International Limited and will try to demonstrate the save use of this products for the best performance of RO systems.

1. INTRODUCTION

Water treatment throughout RO membranes technology is already widely applied, but there is still much effort being done trying to develop membranes with different chemistry and morphology. This effort is still needed in order to improve membranes performance, mainly trying to minimize fouling on membranes surface, since as a matter of fact fouling is one of the main causes of membranes performance failures(1).

Previous papers demonstrated that, besides biofilm, colloidal matter is one of the main types of fouling detected on membranes surface both as main and secondary component. Although colloidal matter will gradually affect all membranes, first effects are commonly detected on lead elements (1). The main consequence of membrane fouling by clay minerals is an increase of hydraulic resistance, resulting in a greater energy requirement to operate process (2). Besides, in presence of colloidal matter an increase in Δp is expected and an irreversible damage of the membrane surface may certainly occur as a final consequence. Due to the common presence of colloidal matter on membranes surface, some specific cleaners have been developed with very successful results (2) but it is necessary to optimize plant pretreatment as much as possible in order to get a minimum colloids amount reaching the membranes anyway.

Even technical membrane manufacturers manuals point out that the best way to remove colloidal matter from water is to agglomerate fine particle size colloids as large particles, that can be removed more easily using either media or cartridge filtration (3). Among the range of pretreatment chemicals that can be used for particles agglomeration, cationic flocculants are particularly effective for colloidal matter removal, but their use in membrane applications is sometimes limited because it is still thought that the use of them can be detrimental to membrane operation (4). On previous works we already explained that cationic flocculants can be acrylamide copolymers with a cationic monomer, cationically modified acrylamide or a polyamine. In these polymers, the charge can be located either on a pendant group or in the backbone of the polymer chain (4).

Genesys International manufactures a range of cationic products that have been successfully tested in our laboratory for colloidal particles removal at different water sources. These products improve the performance of the filtration equipment and have been developed as a general purpose flocculant to use in surface, well and process water with medium to high SDI values. These flocculants are liquid and fully miscible with water, which makes it very easy to handle and dose them. Their names and main characteristics are included below.

GENEFLOC GPF	GENEFLOC PWF	GENEFLOC ABF
Approval for drinking water applications in some countries (local regulations)	This flocculant conforms to European Standard EN 1408:1988 for use in the treatment of water intended for human consumption.	Genefloc ABF acts as a combined biocide and flocculant, reducing the effect of colloids, bacteria and algae on membrane systems.
Between 1 and 4 mg/L	Between 2 and 5 mg/L	Between 2 and 10 mg/L
<p>These flocculants should be steadily dosed to the feed water, allowing at least 5 minutes contact time before filtration.</p> <p>These flocculants are liquid, can be diluted and are fully miscible with water in all proportions.</p>		

2. MATERIALS AND METHODS

Jar-tests were developed by using both turbidity measurements (HACH 2100P ISO) and particle size distribution (Spectrex PC 2200). The use of these different techniques for testing water pretreatment improvement is widely explained on previous papers (5).

Membrane tests were carried out using Hydranautics CPA3 and SWC5+ blanks on a flat test rig by using standard solutions of NaCl 1.500 ppm (brackish water) and 32.000 ppm (sea water) and were operated at 225 psi and 800 psi respectively.

3. RESULTS AND DISCUSSION

Genesys Membrane Products laboratory is specialized on RO membrane autopsies and, as a complement of these autopsies, the lab carries out analyses of different components from plants pretreatment. Over the last 10 years, GMP laboratory has developed more than 750 membrane autopsies, 300 cartridge filters and around 350 SDI filters.

SDI filters analyses are the best way to identify the nature of suspended matter in water. Among common components detected on these filters are colloidal matter (aluminosilicates) metals (both as oxide and as particles from corrosion drags), microorganisms (diatoms, for example) and organic matter. Although all these components have been detected on SDI filters in our labs, the most common component identified on most them is **colloidal matter**.

Another useful tool to identify suspended matter is cartridge filters analysis. The identification of the matter retained on the surface of security filters, give valuable information on the matter which has not been retained on the previous treatment process, most commonly a sand filter. On the other side, the analysis of these filters can also give information about microfilters efficiency. Photographs 1 to 3 show some examples of cartridge filters with a different fouling on the surface. Besides, some microphotographs from different kind of filters fouling are included. As for SDI filters, aluminosilicates (colloidal matter) are the most common component detected on microfiltration systems.





Photograph 1.-Fouling on both external and internal surfaces





Photograph 2.-Fouling on external surface filter




Photograph 3.-Fouling on internal surface filter

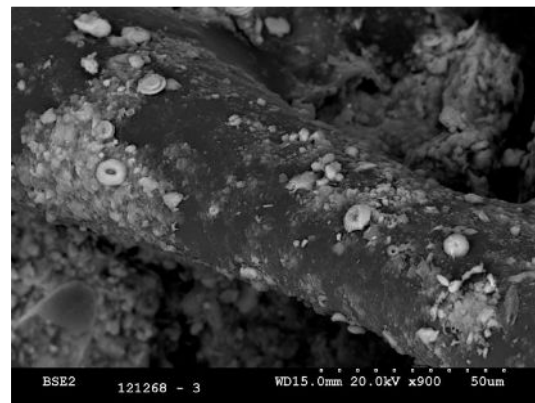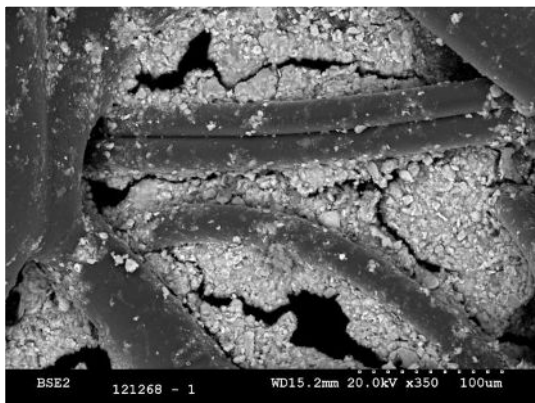

Microphotographs 1.- Cartridge filters fouled by aluminosilicates / colloidal matter

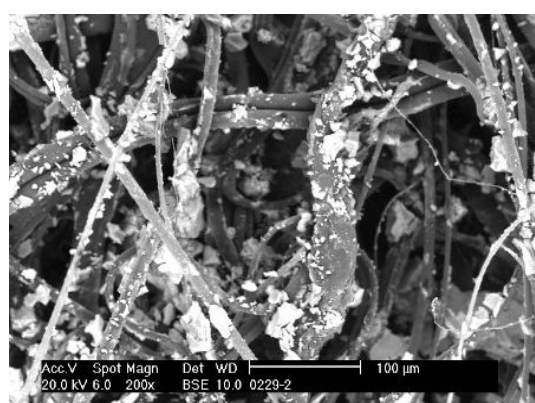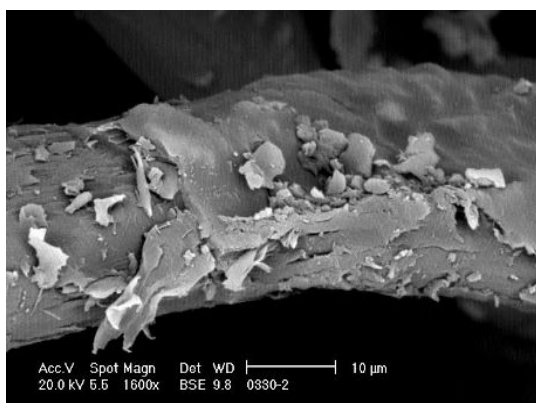

Microphotographs 2.- Cartridge filters fouled by organic matter + calcium carbonate (left) and metals (right)

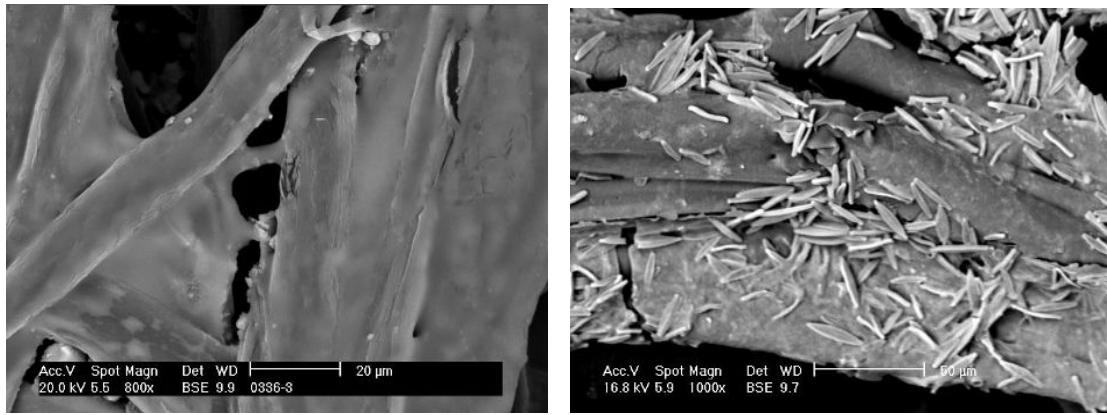


Microphotographs 3.- Cartridge filters fouled by organic matter (left) and diatoms (right)

Depending on the amount of matter that may reach these security filters, they will be able to work more or less efficiently and aluminosilicates might escape and eventually reach membranes surface. When different SDI membranes disks from the different pretreatment components are analyzed, it is quite common to verify that there is a decrease on the presence of the aluminosilicates from the raw water to the RO inlet water. However, in many cases, we have detected that the quality of water concerning suspended matter gets worse after cartridge filtration. This is mainly because, when filters get overloaded, there are leakages from them to the RO system.

On the other side, when both autopsies and cartridge filter analyses from the same plant are carried out, the same fouling is mostly found on both cartridge filter and membrane surface.

As already explained, aluminosilicates are one of the most common components of RO membranes fouling, both as main and secondary. Besides a decrease on the permeate flow, the last consequence of aluminosilicates presence on membrane surface is an increase in delta p. Thus, there is a clear risk of damage of the membrane surface by a possible spacer protrusion, marks from spacer or abrasion marks. The following microphotographs show examples of damage on membranes with a relevant presence of aluminosilicates on the membrane surface. All this data indicates once more the need of colloidal matter removal prior to RO membranes.

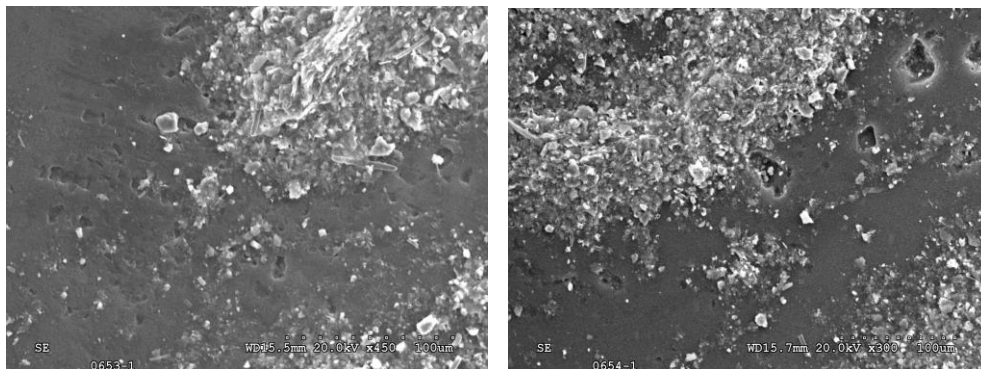


Microphotographs 4.- Damage on membranes surface due to the presence of aluminosilicates


3.1. JAR-TEST RESULTS

As already mentioned, the best way to remove colloidal matter from water is to make fine particles agglomerate into larger particles by using coagulants and/or flocculants and to retain them on a filtration system. The best tool in the selection of the most suitable flocculant for colloidal matter removal is a jar-test. When a jar-test is developed for a settling or DAF process, it is necessary to look for a big floc with settling or floating characteristics. But colloidal matter removal must be carried out through a filtration process and this requires to get microflocs with no real settling or floating properties. In many cases, it is not possible to detect these microflocs visually.

On the other side, the main effect of this kind of compounds in water pretreatment is the improvement of SDI values (Silt Density Index), but this parameter cannot be measured in laboratory. The only test that could relate SDI measurements and laboratory tests would be to verify the efficiency of flocculants on SDI value reduction. The following microphotographs 5 and 6 show SDI filters surface obtained after raw water filtration and after filtration of the water obtained after flocculant dosing. As it can be observed, it is not possible to distinguish filter structure on SDI filter from raw water (microphotograph 5). With the increase of flocculant dosing a filter structure could be distinguish and SDI values were lower than before the use of the product (microphotograph 6).

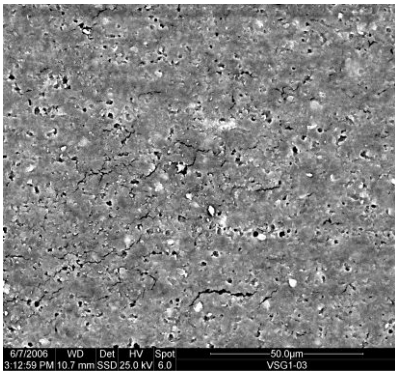

Microphotograph 5.- SDI filter obtained after raw water filtration. SDI value: no measurable (infinite)

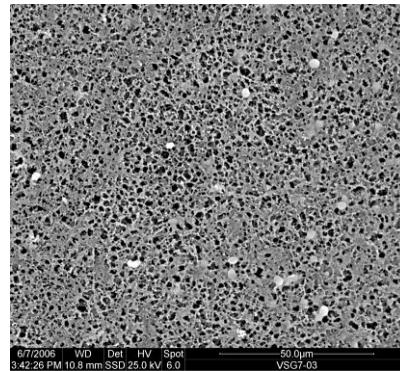


Microphotograph 6.- SDI filter obtained after 5 ppm flocculant dosing. SDI value: 4.3

Provided the impossibility of testing SDI values in a laboratory, water parameters related to suspended matter such as turbidity or particle size distribution are the best way to demonstrate if a product is suitable for particle agglomeration (5). Next chapters will include results obtained during jar-tests carried out with the different cationic flocculants manufactured by Genesys International.

3.1.1. Genefloc PWF results

This product conforms to European Standard EN 1408:1988 for use in the treatment of water intended for human consumption. It has been applied at different sites working with different kind of water, volume production and application, combined with different antiscalant. At all these sites, Genefloc PWF has been successfully applied.

As the rest of flocculants studied for this paper, Genefloc PWF is very successful on colloidal matter removal. As an example, the following microphotograph 7 shows an SDI disk surface completely fouled by aluminosilicates (colloidal matter). This study corresponds to a well water with a very high turbidity level (19,1 NTU) which even filtered through 20-25 μm , still gave a turbidity value of 11.0 NTU. The figure included below shows how with a growing dosing of Genefloc PWF, there is a very relevant decrease of filtered water turbidity, reaching values even lower than 1 NTU with 9 ppm of product.

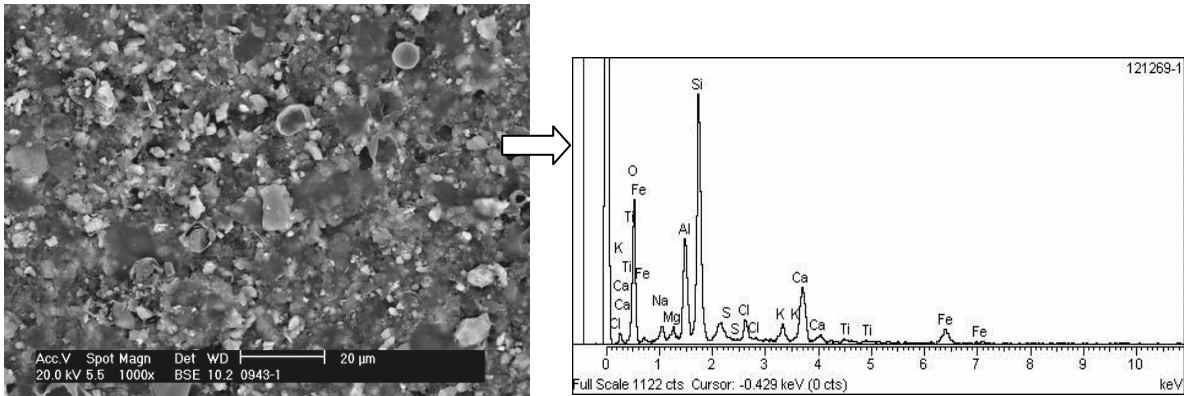

Microphotograph 7.- SEM image of an SDI disk completely covered by aluminosilicates (clay/colloidal matter)

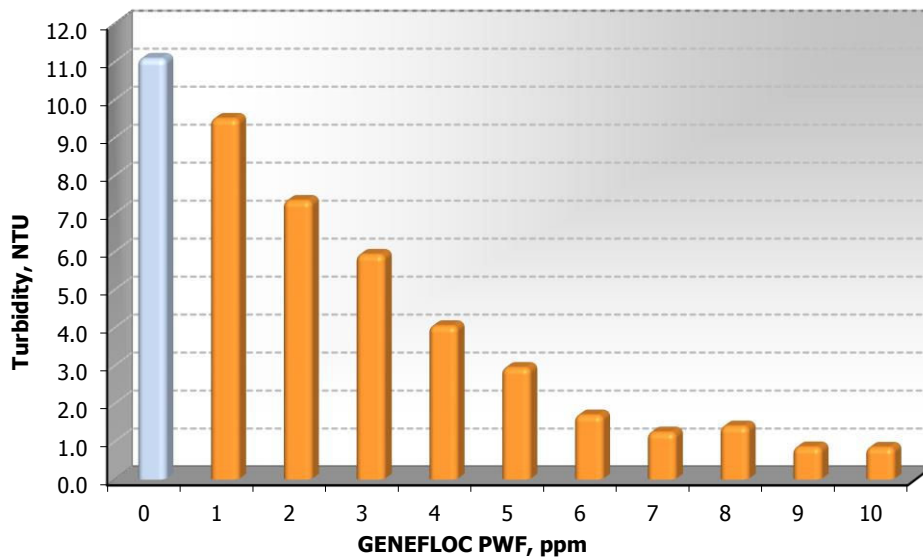


Figure 1.- Turbidity values obtained after Genefloc PWF dosing and later filtration

3.1.2. Genefloc GPF results

Genefloc GPF is Genesys flocculant mostly applied. It has been successfully tested on 95% of the jar-test carried out in our laboratories. The high number of tests developed using this product has enabled us to verify that, besides fine colloidal particles agglomeration, it can be successfully applied in water samples with suspended matter of very different nature: colloidal silica, metallic particles, etc.

Next figure 2 represents some turbidity values obtained during a jar-test with GPF working with a water sample with a low turbidity but high SDI values. When water has low turbidity, an increase on turbidity values will be related to the formation of microflocs. This increase in turbidity will only be detected on the samples with suspended matter, since no turbidity increase on water without suspended matter (RO water in this figure 2). If we look into particles size distribution of this sample during jar test (see figure 3), it can be verified how after dosing of the flocculant the maximum percentage of particles detected shifted to a higher particle size.

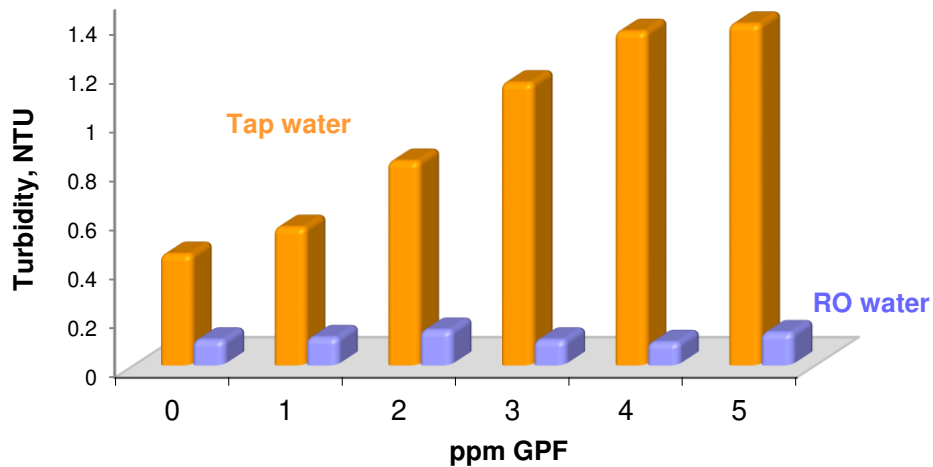


Figure 2.- Turbidity values of a tap water sample after flocculant dosage, compared to a RO water with no particles

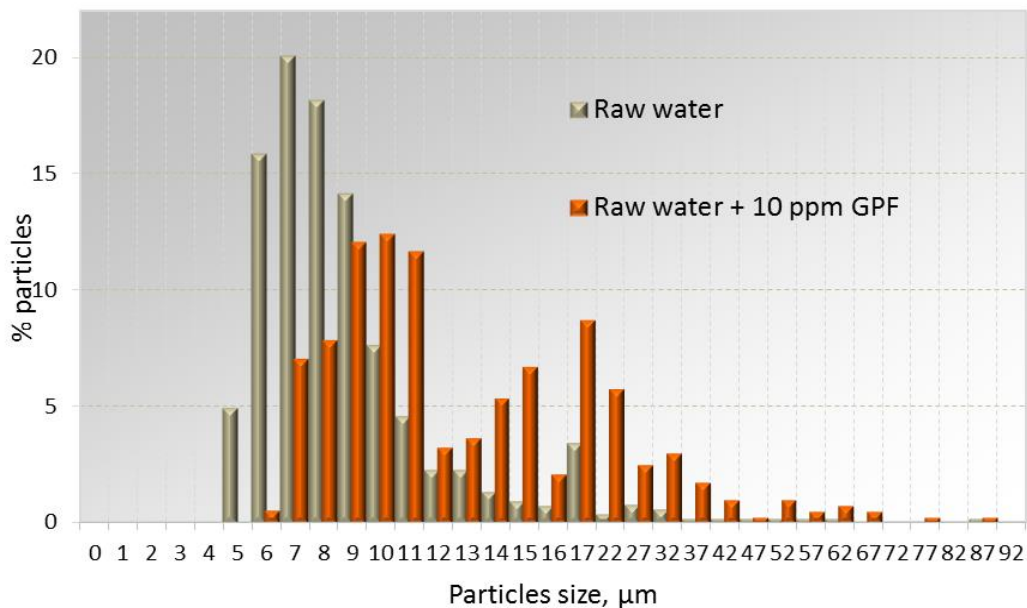


Figure 3.- Particle size distribution of a water sample after additional dosage of flocculant

Besides the agglomerate of fine particles, another advantage in the use of cationic flocculants is that they help to decrease metal residual concentration from the coagulants used during pretreatment of water prior to filtration process. To illustrate this, the following figures 4 and 5 include some real iron and aluminium concentration values, which suffered a relevant decrease when a cationic product was used during filtration.

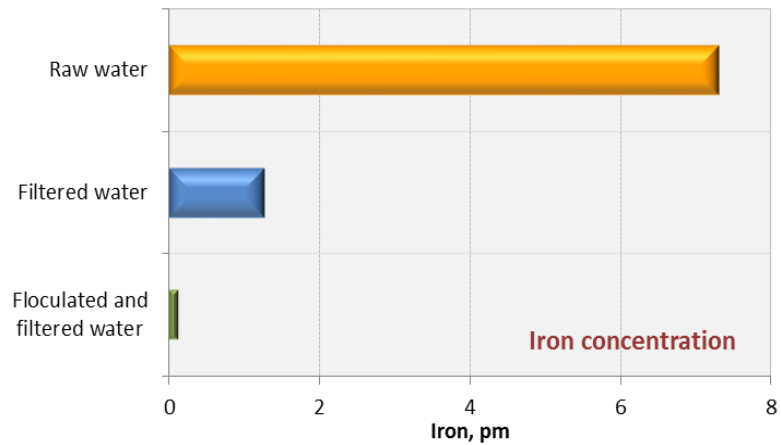


Figure 4.- Iron concentration during filtration process with and without flocculant (Genefloc GPF)

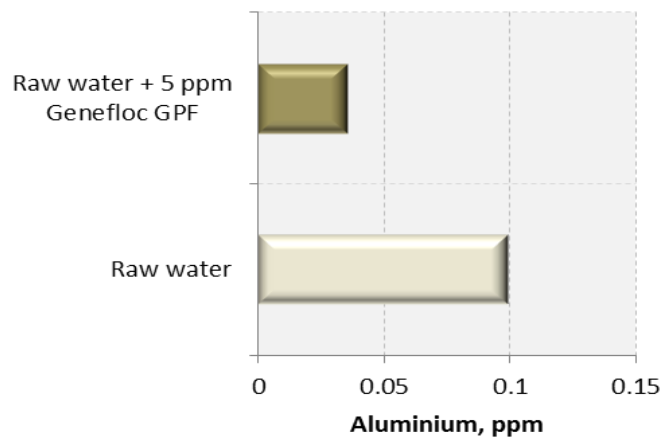


Figure 5.- Aluminium concentration during filtration process with and without flocculant (Genefloc GPF)

3.1.3. Genefloc ABF results

Genefloc ABF combines different active ingredients in order to provide different properties: flocculant, biocide and algaecide. Genefloc ABF reduces water surface tension and acts on the normal functions of cell membranes preventing growth. Genefloc ABF interacts with the phospholipids of the cell membranes of microorganisms while another non-polar molecule of this product enters the cell decreasing cell membrane permeability and changing its protein activity. Although its optimum activity is at pH values higher than 7, it can be used at any pH range.

Due to this fact, and depending on the kind of water, this product may be more suitable as a flocculant or as a biocide.

When acting as a flocculant, many tests carried out in our laboratories demonstrate that Genefloc ABF is a suitable product for agglomeration of fine particles. Figure 6 shows filtered water samples turbidity after an increasing ABF dose. As this figure shows, filtered water turbidity suffers a relevant decrease from the first tested concentration.

On the other side, the characteristics of this product make that on some waters can provide a similar performance to anionic flocculants (mainly against organic suspended components). As an example, figure 7 includes a comparison of the turbidity obtained from different flocculants addition to a surface water sample. As it can be observed in this water sample, although GPF and PWF achieve a successful decrease of turbidity, Genefloc ABF allows the lowest turbidity value. The result obtained with this flocculant is even better than the one obtained when using an anionic flocculant, which is supposed to work better with surface water.

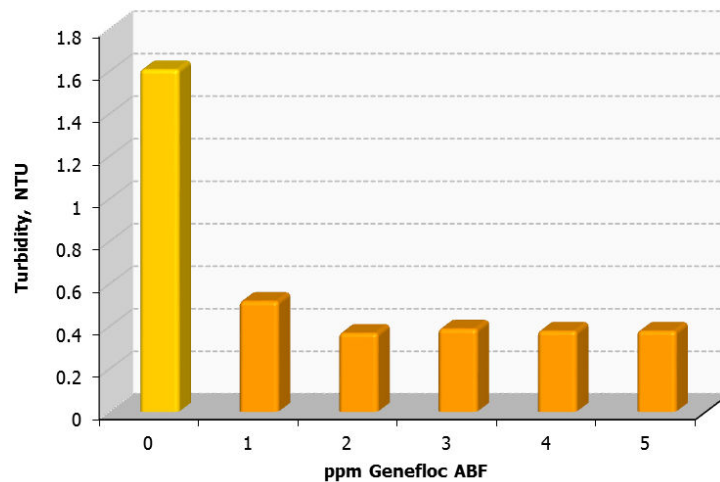


Figure 6.- Filtered water sample turbidity after different Genefloc ABF dosing

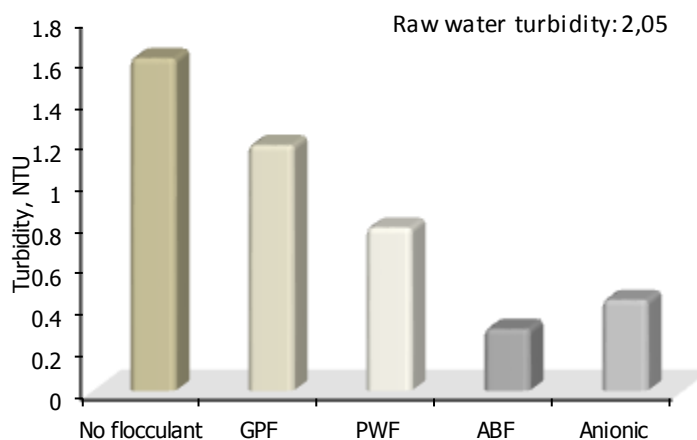


Figure 7.- Filtered water samples turbidity after different flocculants dosing

As explained before, Genefloc ABF shows biocide characteristics that make it active against some microorganisms. The following figure illustrates a relevant reduction of aerobic bacteria when ABF dose is increased. Therefore, this product is broadly applied as biocide on systems which cannot control chlorine or mainly when there is a high presence of algae, although there are also many applications of it as flocculant.

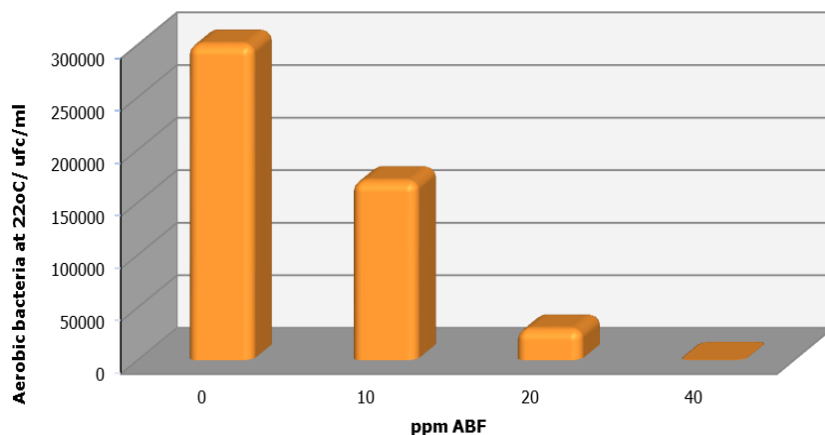


Figure 8.- Genefloc ABF activity against aerobic bacteria

3.2. FLOCCULANTS COMPATIBILITY TESTS

Genesys cationic flocculants have been successfully applied in field and no relevant changes on membranes performance have ever been detected. On the other side, from the 750 autopsies developed in our laboratories, only on 1 % of them fouling was related to flocculants. These flocculants were polyacrylamide derivatives, not cationic flocculants.

Anyhow, some tests were developed in Genesys Membrane Products laboratory in order to understand as much as possible about the compatibility of flocculants and membranes. These tests were carried out checking the performance of membrane after being in contact with an overdosing of flocculants through two different ways:

- Soaking tests: Membrane coupons were soaked during one week in a 1g/L flocculant solution and after that period both membrane performance parameters and membrane surface were analyzed.
- Compatibility tests during membrane performance: These tests were carried out by adding 100 ppm of flocculant during membrane operation and performance parameters were measured during four hours.

3.2.1. Soaking tests

Figures 9 and 10 represent flow rate and salt rejection percentage values after a period of one week soaking in 1 g/L of each product. As it can be observed, the soaking period doesn't affect the performance of membrane coupons with none of the cationic flocculants tested.

A lower permeate flow rate was observed after soaking period in anionic flocculant for sea water membrane and in non ionic flocculant for brackish water membrane.

As complement to these parameters, both SEM-EDX and ATR-FTIR analyses were carried out on the coupons obtained after flocculants soaking period.

No presence of flocculants was observed on none of the sea water membrane coupons after the soaking period.

Concerning brackish water membranes, SEM-EDX analyses revealed presence of an organic component on the anionic flocculant coupon (see microphotograph 3). Besides, IR analyses showed that only membrane coupons obtained after contact to anionic (figure 11) and nonionic flocculants (figure 12) showed some IR bands different that those from membrane composition and showed coincidences to flocculants presence. There is no way to demonstrate by this technique whether the presence of these flocculants is due to a reaction or just a deposition.

However, what these results demonstrate is that none of the cationic flocculants show a reaction or direct effect on polyamide layer.

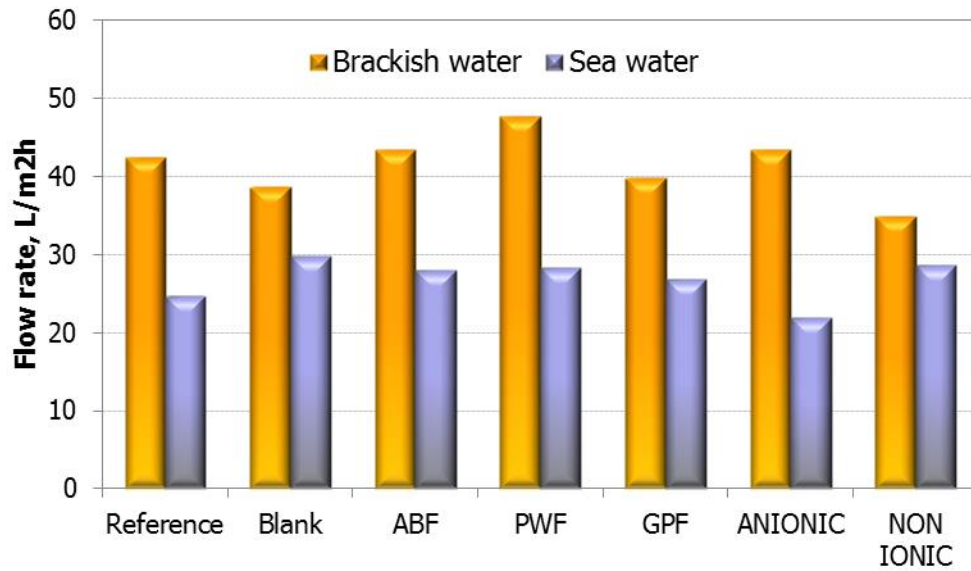


Figure 9.- Permeate flow rate performance parameters after soaking period in 1g/L flocculant solution



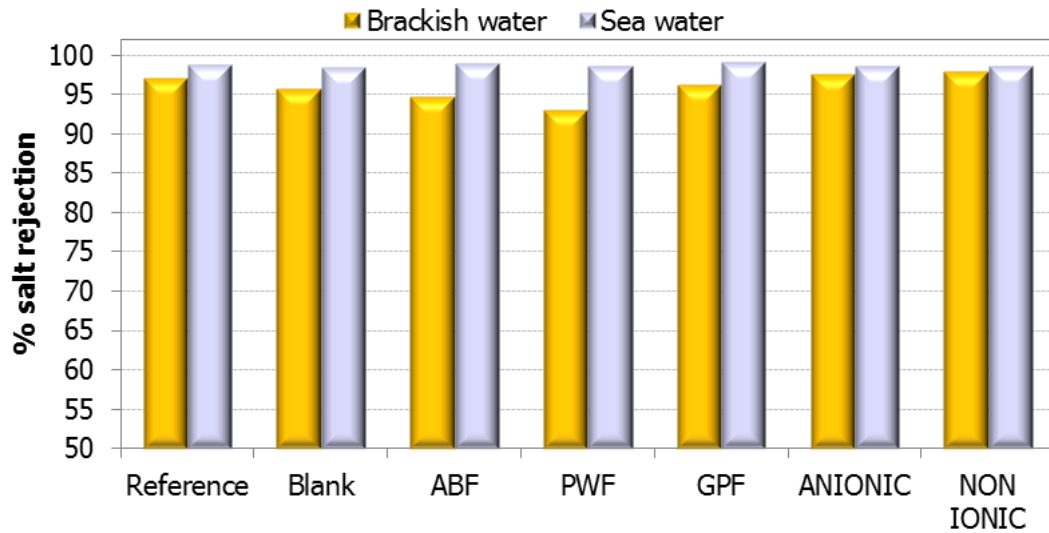



Figure 10.- Salt rejection percentage performance after soaking period in 1g/L flocculant solution

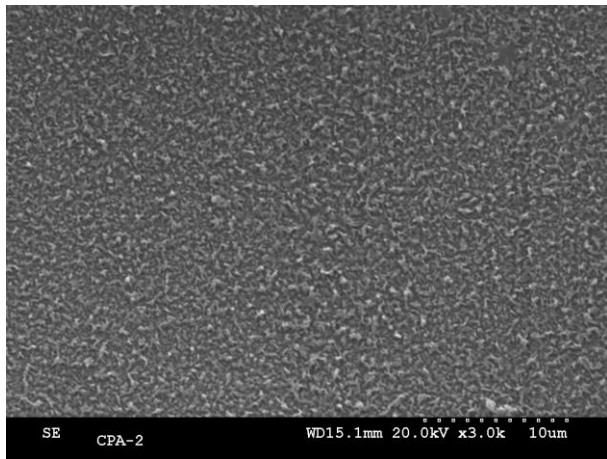


Microphotograph 1.- Detail of membrane blank surface (brackish water)

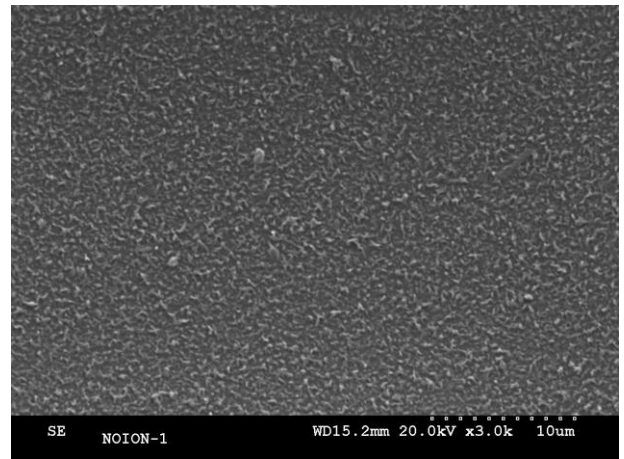


Microphotograph 2.- Detail of membrane surface after soaking on non ionic flocculant solution (brackish water)

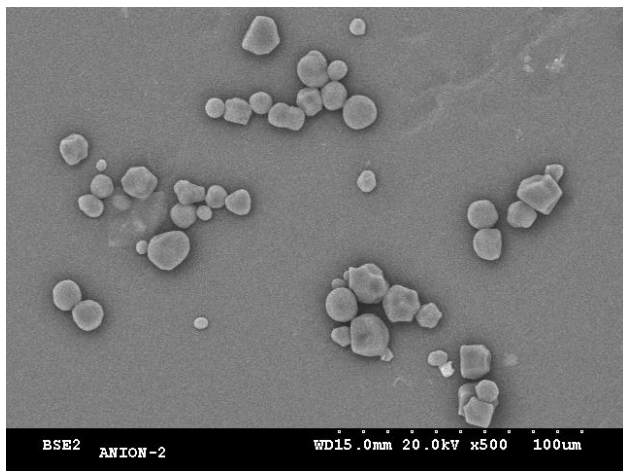


Microphotograph 3.- Detail of membrane surface after soaking on anionic flocculant solution (brackish water)

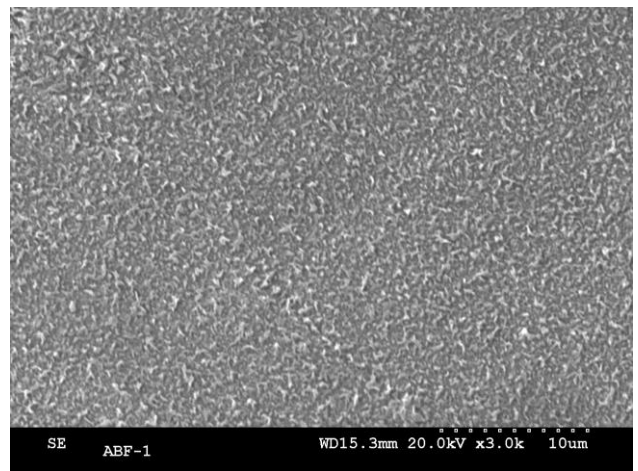

Microphotograph 4.- Detail of membrane surface after soaking on ABF flocculant solution (brackish water)

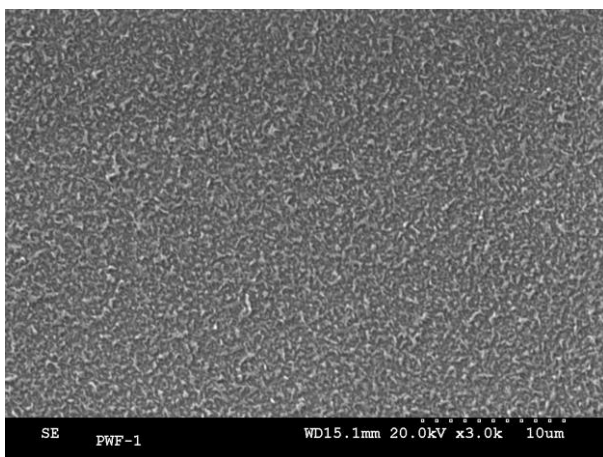

Microphotograph 5.- Detail of membrane surface after soaking on PWF flocculant solution (brackish water)

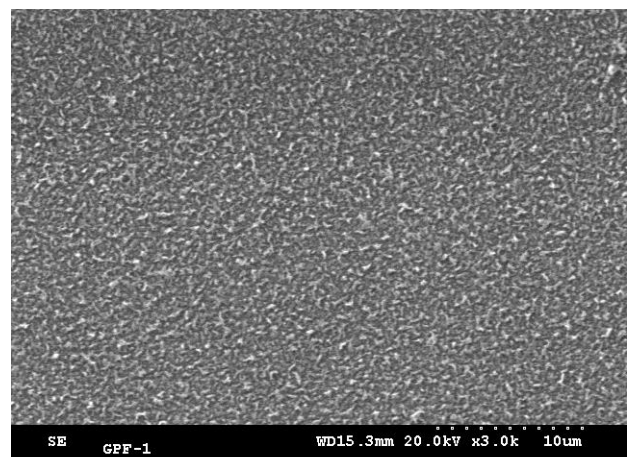

Microphotograph 6.- Detail of membrane surface after soaking on GPF flocculant solution (brackish water)

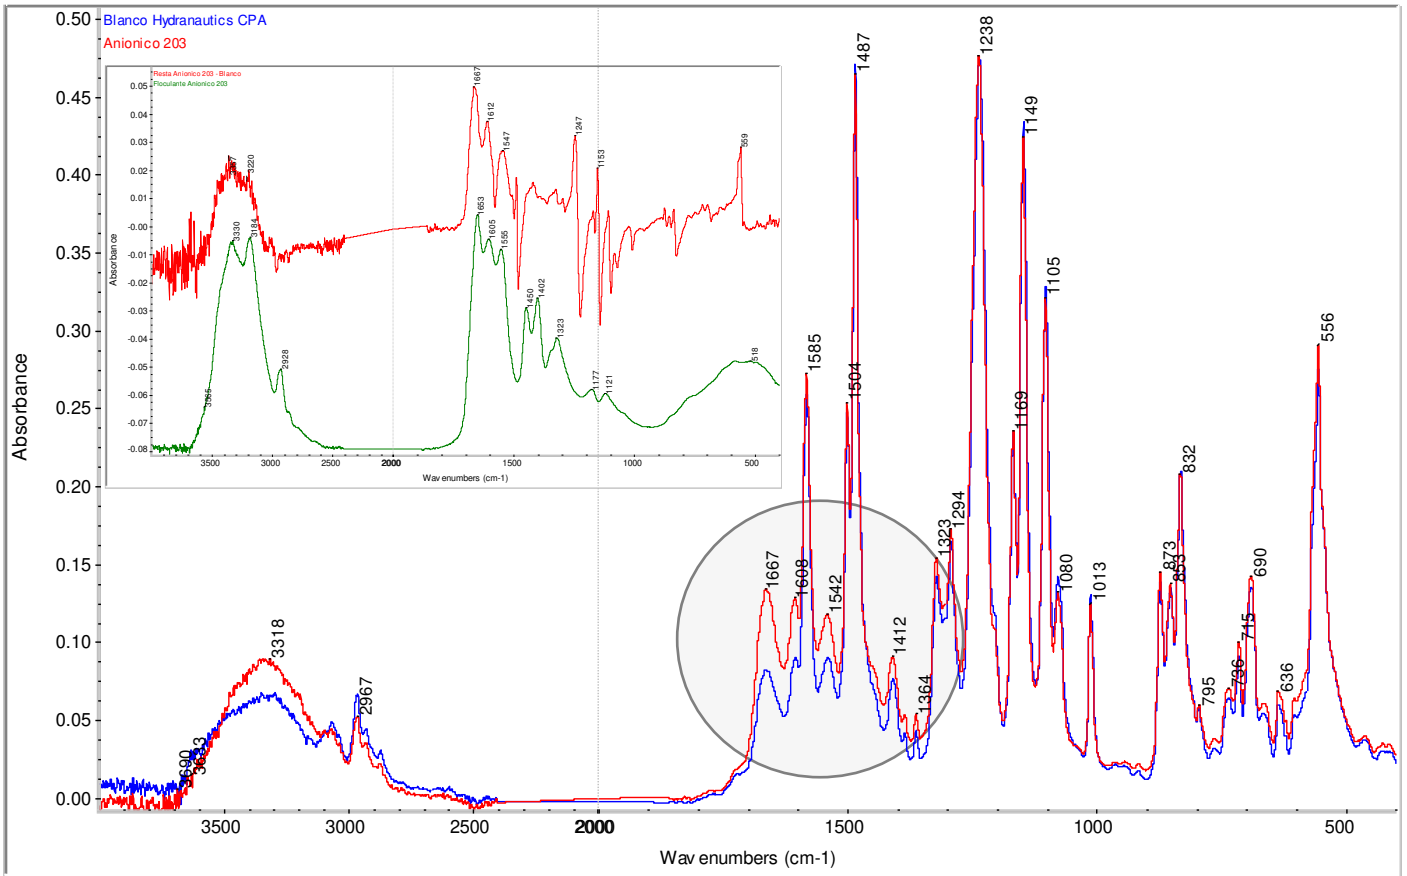


Figure 11.- Comparison of anionic coupon after soaking period to blank membrane spectra (brackish water)

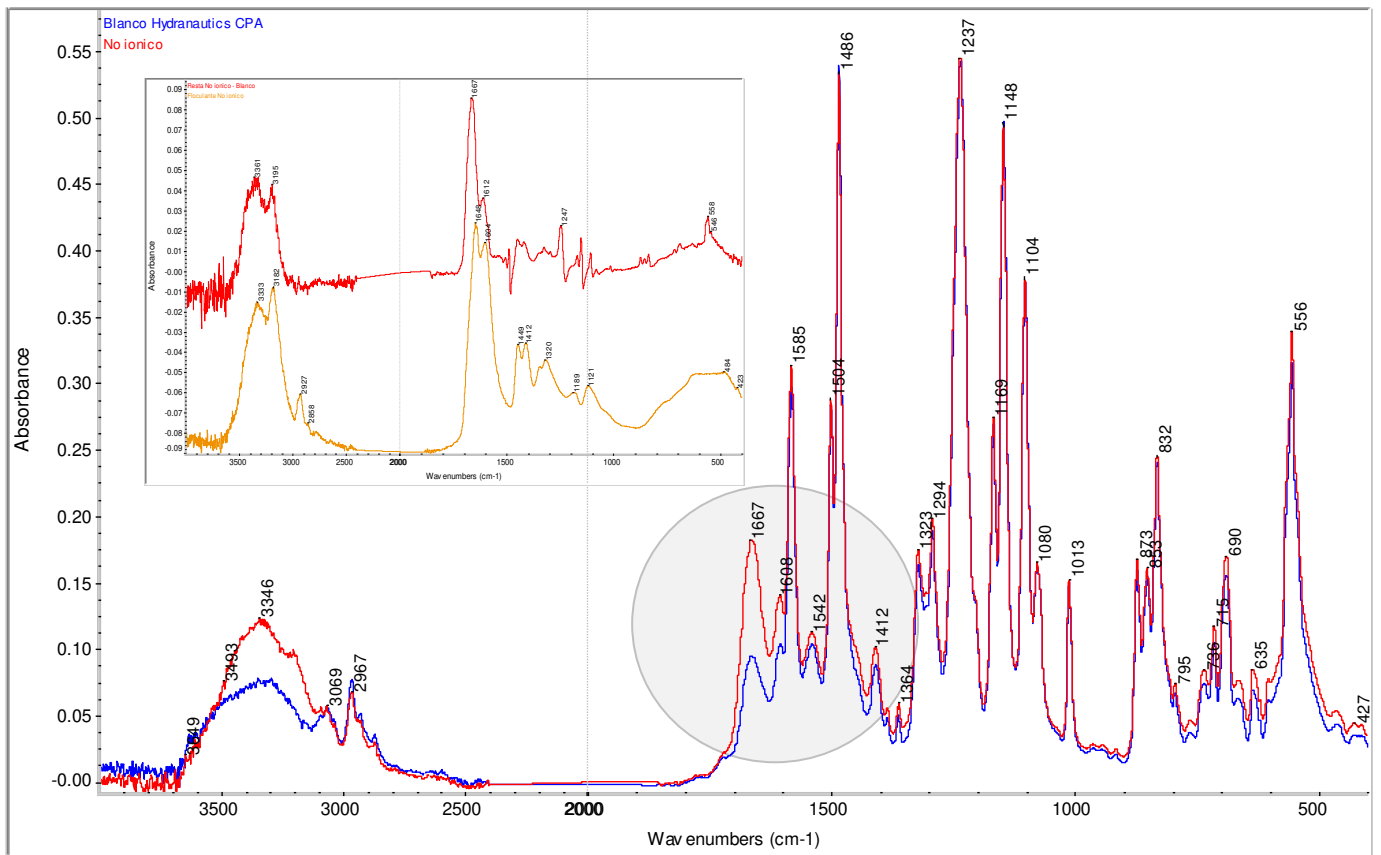


Figure 12.- Comparison of non ionic coupon after soaking period to blank membrane spectra (brackish water)

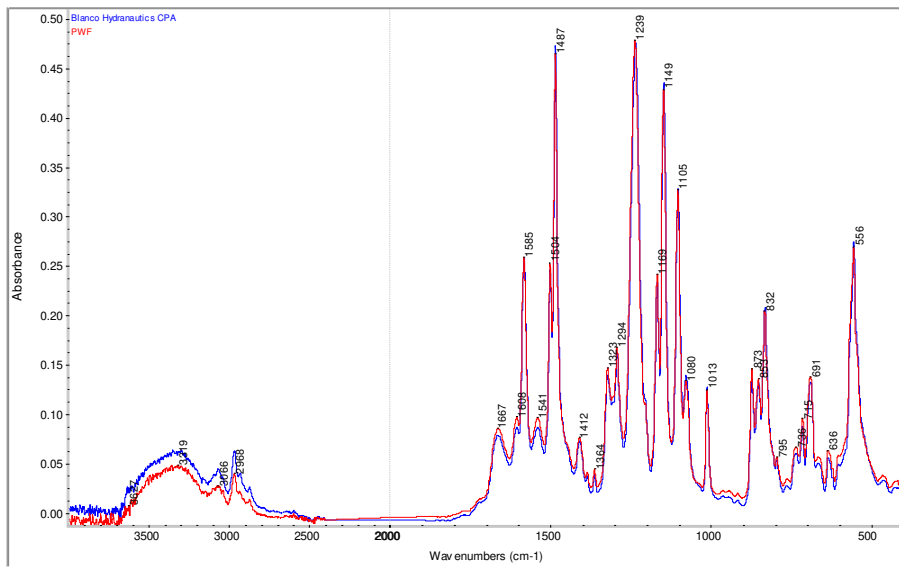


Figure 13.- Comparison of PWF coupon after soaking period to PWF flocculant spectra (brackish water)

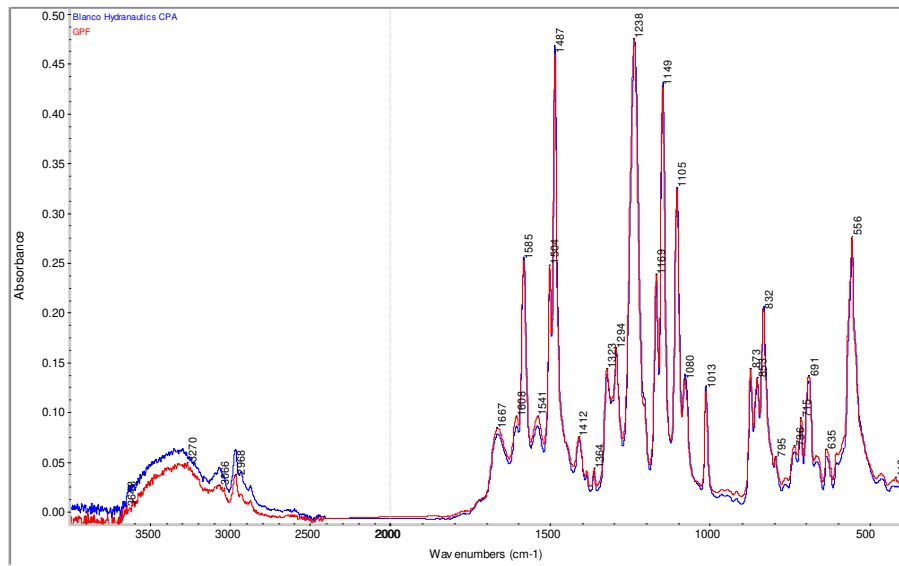


Figure 14.- Comparison of GPF coupon after soaking period to blank membrane spectra (brackish water)

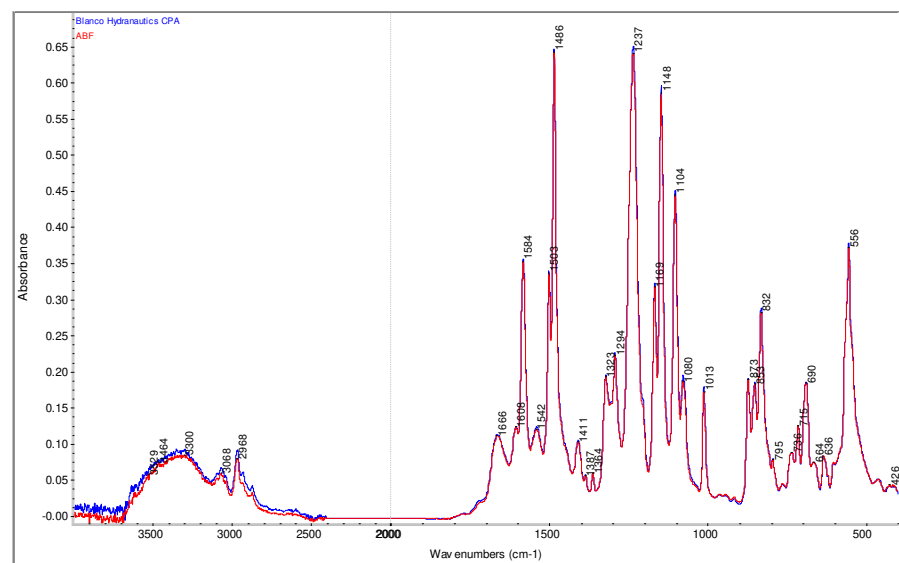


Figure 15.- Comparison of ABF coupon after soaking period to blank membrane spectra (brackish water)

Besides these tests, and additional study was carried out checking possible changes on the performance of membranes after overdosing of flocculant. In this case, flow rate was checked during a period of 4 hours after dosing 100 ppm of each flocculant, except for Genefloc ABF which was tested at 500 ppm (dose used for disinfection). Figure 16 corresponds to a comparison of the flow rate obtained from a brackish membrane blank compared to the performance obtained from same membrane model after adding 100 ppm or 500 ppm of each flocculant.

As it can be observed, membrane blank coupon already shows a small decrease of flow rate as time goes by. With the dosing of flocculants, this flow decrease on flow rate is slightly higher, although none of them showed a change higher than a 15% (common coefficient of variation admitted by membrane manufacturers for individual elements). In any case, trying to prevent an eventual fouling after overdosing these products, a 2 hours cleaning procedure with an alkaline product (Genesol 703) was carried out on these coupons and the flow rate was easily recovered on all of them.

These results indicate that although a slight fouling could happen on membrane surface after overdosing the cationic flocculants tested, this wouldn't be due to any reaction between polyamide and flocculant and that membrane performance could be recovered after a conventional cleaning. However, since membrane blank also suffers a decrease during performance it is very difficult to determinate whether this different behavior could be attributed to the flocculant.

The changes observed during this test with brackish water membranes were even lower for sea water membranes (figure 17).

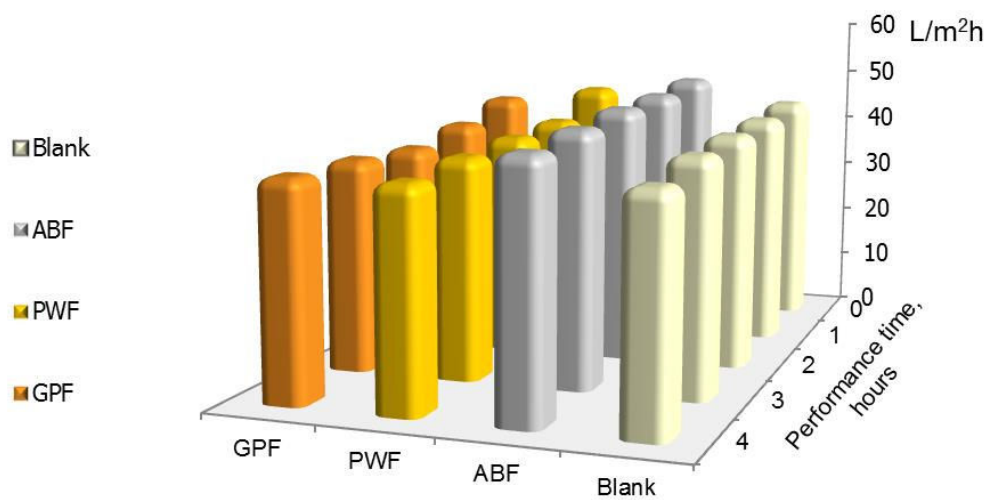


Figure 16.- **Brackish water membrane** performance after flocculant dosing

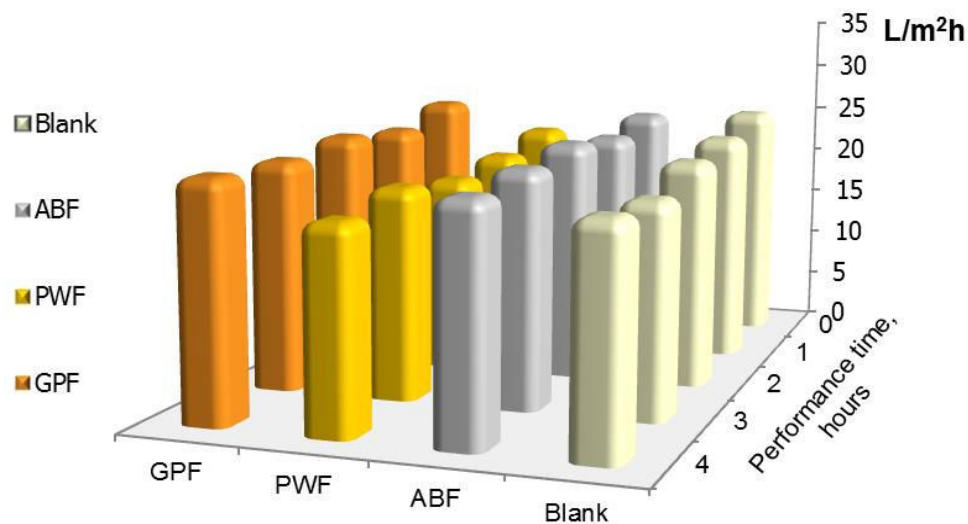


Figure 17.- **Sea water membrane** performance after flocculant dosing

3.3. FLOCCULANTS INTERACTION TO ANTISCALANT

Besides a possible interaction between membrane polyamide layer and cationic flocculants, there is also a belief that cationic flocculants will react to antiscalant due to its negative charge, forming a dangerous gel for membrane performance. In order to know as much as possible about this interaction, some tests were carried out in our labs with Genesys cationic flocculants and the most widely used antiscalant manufactured by Genesys: Genesys LF.

For this test, different doses of Genesys LF were added to 10 ppm (see figures 18 and 20) and 100 ppm of each flocculant (unrealistic overdosing, see figures 19 and 21). These tests were based on turbidity measurements, considering that an increase on turbidity values will be related to an interaction between flocculant and antiscalant. These tests were carried out both on a demin water and on a 32 g/L of NaCl solution.

As it can be observed in figures 18 and 19 (demin water), turbidity remains mainly stable on both 10 and 100 ppm of GPF and PWF flocculant, until a dosing of **40 ppm of Genesys LF**. This effect is not so relevant for flocculant ABF and the increase in turbidity is not so significant at a very high concentration.

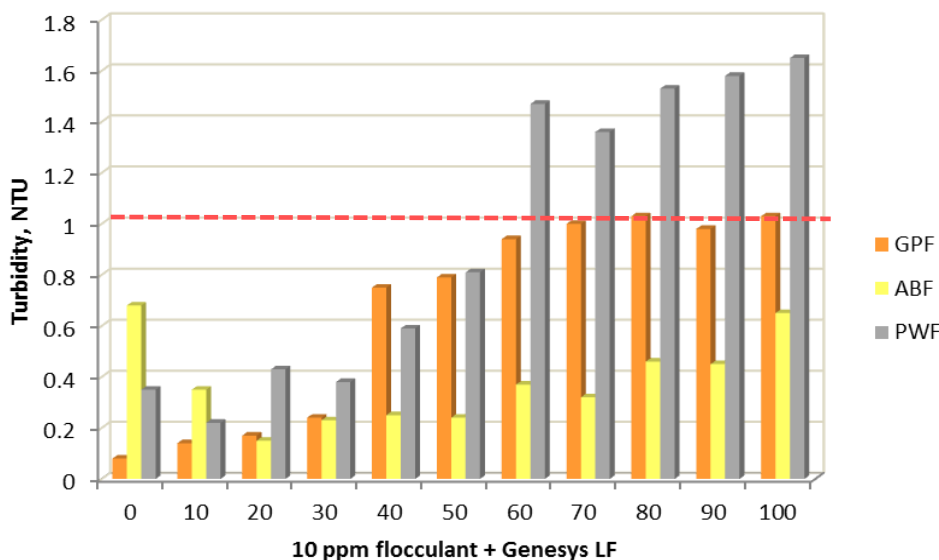


Figure 18.- Turbidity changes after Genesys LF dosing on a **10 ppm of flocculant solution-demin water**

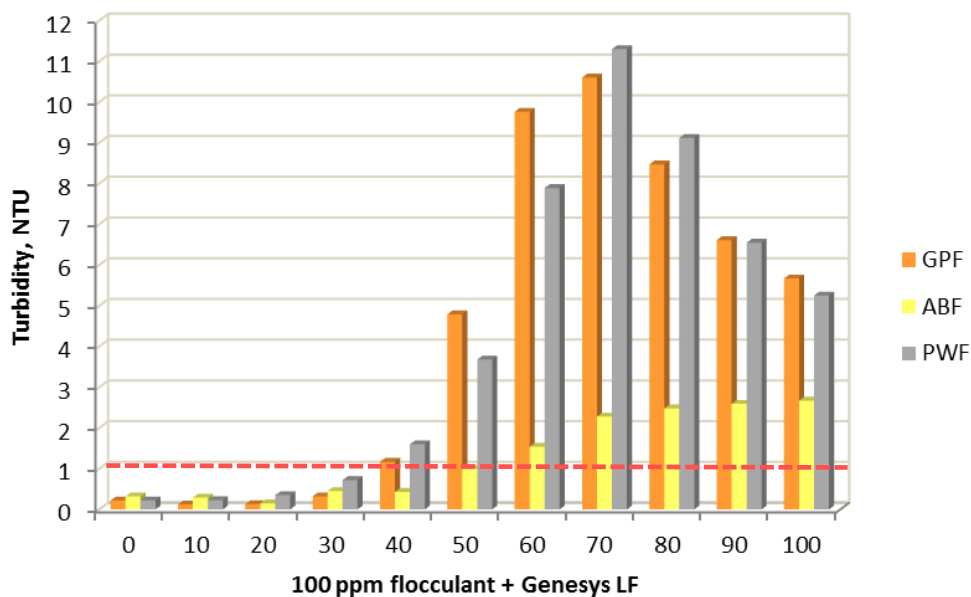


Figure 19.- Turbidity changes after Genesys LF dosing on a **100 ppm of flocculant solution -demin water**

Concerning the behavior of antiscalant vs flocculant at sea water systems, the following graphs show the same study in high salinity water. According to these graphs, sea water doesn't show any relevant change after antiscalant addition to a fixed flocculant concentration.

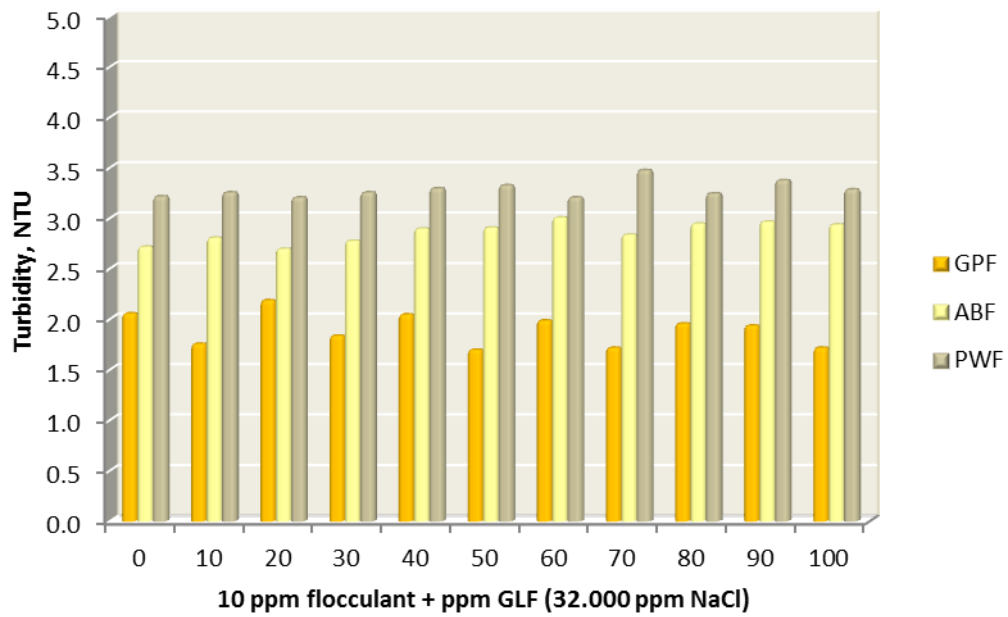


Figure 20.- Turbidity changes after Genesys LF dosing on a 10 ppm of flocculant solution – sea water

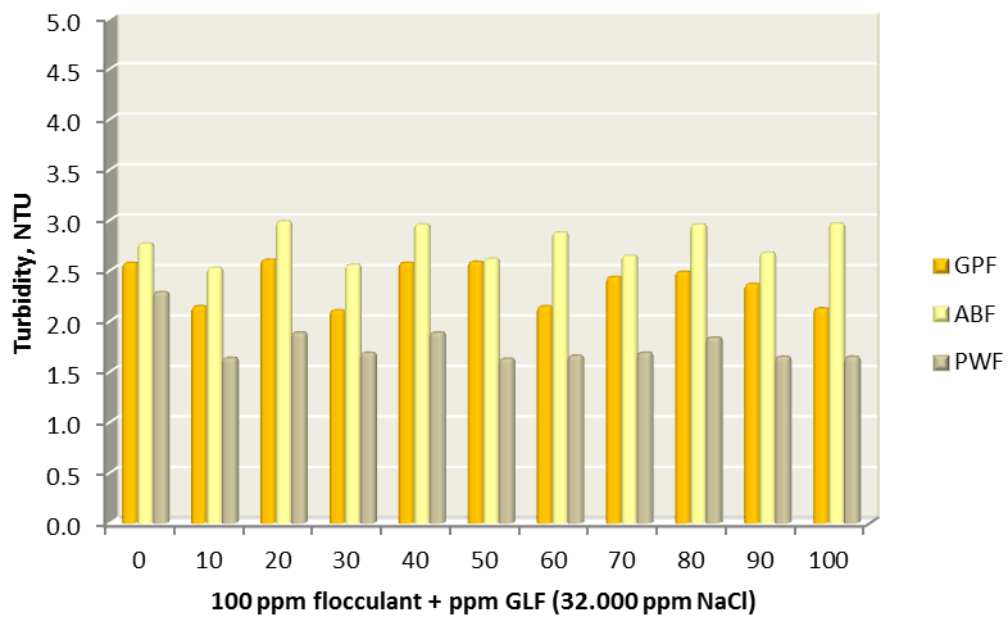


Figure 21.- Turbidity changes after Genesys LF dosing on a 100 ppm of flocculant solution – sea water

Even though a very high overdosing of both flocculant and antiscalant is necessary for an interaction between them, additional tests were carried out in order to know the effect of this mixture on membrane performance. In this case, these tests were only carried out on brackish water membranes, because these are the systems that use a higher concentration of antiscalant.

The following figure 22 shows flow rate change during 3 hours of membrane performance after a 100 ppm Genesys LF dosing and 100 ppm of each cationic flocculant. As it can be observed, there is not a relevant change on flow rate membrane performance, which indicates that membrane doesn't suffer a sudden change.

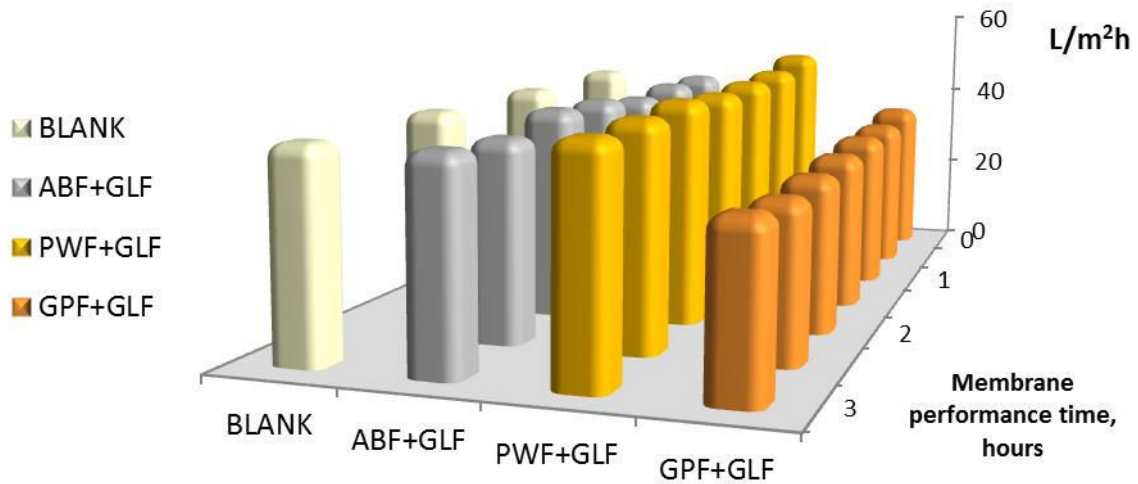


Figure 22.- Permeate flow rate membrane performance after 100 ppm GLF and 100 ppm flocculants dose

The different tests developed in our labs indicate that despite the cationic nature of Genesys flocculants, there is not a significant change on membrane performance if it gets in contact with a flocculant overdosing or with a flocculant+antiscalant overdosing.

CONCLUSIONS

- Flocculants studied in this work are very efficient for agglomeration of fine particles, so they can be used to improve filtration processes performance, mainly for colloidal matter removal.
- Both turbidity and particle size distribution analyses are perfect tools for the study of these flocculants in water, since they are the only way to verify the microflocs obtained in most of the samples.
- These flocculants don't show any relevant interaction to membranes surface.
- Overdosing of these products achieve a minimum effect on membranes performance.
- Flocculants and antiscalant GLF only showed some interaction at very high and unrealistic concentration. Contact of this mixture to membrane didn't show any relevant change on performance.

REFERENCES

- (1) N. Peña, S. Gallego, F. del Vigo, S.P. Chesters. Evaluating impact of fouling on reverse osmosis membrane performance. *Desalination and Water Treatment* 1-11 2012.
- (2) M.W. Armstrong, S. Gallego, S.P. Chesters, *Cleaning Clay from fouled membranes*. *Desalination and Water Treatment* 10 (2009), 108-114.
- (3) Dow Liquid Separations. Technical Manual 2004.
- (4) S.P. Chesters, E.G. Darton, S. Gallego, F.D. Vigo. The safe use of cationic flocculants with reverse osmosis membranes. *Desalination and Water Treatment*, 6 (2009) 144-151.
- (5) E.G. Darton, S. Gallego. Simple laboratory techniques improve the operation of RO pre-treatment systems. IDA World Congress-Maspalomas, Gran Canaria-Spain, October 21-26, 2007